

# BS-530/1/WP WATERPROOF SOUNDER FOR FIRE DETECTION PANEL



## TECHNICAL CHARACTERISTICS

OPERATION VOLTAGE	21-28V DC
MAXIMUM CONSUMPTION	1.2W
MAXIMUM SOUND OUTPUT in1m	94dB (sound effect 1)
TYPE OF APPLICATION ENVIRONMENT	Type B
MOUNTING	Wall
DEGREES OF COVER PROTECTION	IP 65
PRODUCED IN ACCORDANCE WITH	EN 54-3:2001 +A1:2002 +A2:2006
OPERATION TEMPERATURE RANGE	0 to 60 °C
RELATIVE HUMIDITY	Up to 95%
CONSTRUCTION MATERIAL	Bayblend FR3010, transparent polycarbonate
EXTERNAL DIMENSIONS	141 x 141 x 95 mm
TYPICAL WEIGHT	230gr.
GUARANTEE	2 years

**Thank you for your trust in our products.  
Olympia Electronics - European manufacturer.**

### GENERAL

This device is a sounder for fire detection panels that offer a strong sound that covers many square metres. It features two inputs (N1, N2) for the production of two different sounds.

This device can co-operate with any fire detection panel (BSR-2104, BSR-2114, BS-1632, BS-1634, BS-1636, BS-636).

### Installation and Connection

**1.** First, remove the retaining screw, place a flat blade screwdriver in the holes of the plastic hooks and remove the plastic cover (Image 1 on page 2).

**2.** Use the supplied mounting parts to install the siren's base on the wall. Place the plastic plugs and fasten the screws to the mounting holes.

**3.** Insert the included sealing rings around the respective recesses (image 2,3 page 2).

**4.** Place the caps and make a hole in the center using a small screwdriver. Pass through the caps the cables to connect the device.

**5.** The (+N1 or the +N2) terminal block is connected to the (+) output of **Alarm-1** or **Alarm-2** of the panel and the (-) of the terminal block is connected to the (-) output of **Alarm-1** or **Alarm-2** of the panel. Accordingly connect in parallel all the sirens. (The maximum number of sirens

depends on the type of the panel).

**6.** To select various **sound effects** use the dipswitch 1, 2 and 3 and choose the diserable sound effect, according to tables 2 and 3 on page 3.

**7.** On the last siren of the line, we must connect in parallel with its power cables, the terminal resistor that was removed from the alarm contacts of the panel.

**8.** Refit the plastic cover until the plastic hooks are securely attached (step 1) and fasten the retaining screw (torque 0.6Nm).

**9.** Test the device after installation.



Image 1



Image 2












Image 3



**NOTE!!!** After finishing the installation, place the SEAL sticker as shown in the picture.

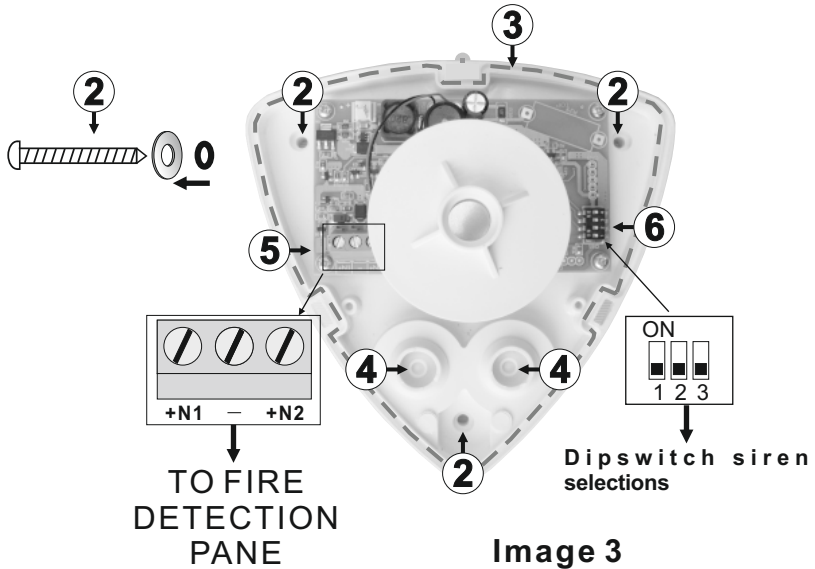







**TABLE 2**

**Fire Detection Panel connection to +N1**

DSW	Nr	Sound effect	Tone in accordance to:	dB	mA
	0	970Hz continuous	BS5839-1:2002 - "evacuate" BS5839 Part 1 1988	91	21
	1	970Hz (1 sec <b>ON</b> - 1 sec <b>OFF</b> )	BS5839-1:2002 - "alert" BS5839 Part 1 1988	94	22
	2	From 1200Hz to 500Hz in 1 sec	BS5839-1:2002 - DIN - Tone DIN33404 Part 3	90	22
	3	From 500Hz to 1200Hz in 3.5 sec - 0.5 sec <b>OFF</b>	NEN2575 (Netherlands)	87	31
	4	800Hz - 970Hz alternate at 1Hz	BS5839-1:2002	91	29
	5	Intermittent 2850Hz (0.5 sec <b>ON</b> - 0.5 sec <b>OFF</b> )	ISO8201 High Frequency	82	27
	6	970Hz (0.5 sec <b>ON</b> 970 Hz <b>OFF</b> x3 times + 1.5 sec <b>OFF</b> )	ISO8201 Low tone - US Temporal Tone LF	92	24
	7	2850Hz (0.5 sec <b>ON</b> 2850 Hz <b>OFF</b> x3 times + 1.5 sec <b>OFF</b> )	ISO8201 High tone - US Temporal Tone HF	83	27

**TABLE 3**

**Fire Detection Panel connection to +N2**

DSW	Nr	Sound effect	Tone in accordance to:	dB	mA
	0	970Hz (1 sec <b>ON</b> - 1 sec <b>OFF</b> )	BS5839-1:2002 - "alert" BS5839 Part 1 1988	94	22
	1	970Hz continuous	BS5839-1:2002 - "evacuate" BS5839 Part 1 1988	91	21
	2	From 500Hz to 1200Hz in 3.5 sec - 0.5 sec <b>OFF</b>	NEN2575 (Netherlands)	87	31
	3	From 1200Hz to 500Hz in 1 sec	BS5839-1:2002 - DIN - Tone DIN33404 Part 3	90	22
	4	Intermittent 2850Hz (0.5 sec <b>ON</b> - 0.5 sec <b>OFF</b> )	ISO8201 High Frequency	82	27
	5	800Hz - 970Hz alternate at 1Hz	BS5839-1:2002	91	29
	6	2850Hz (0.5 sec <b>ON</b> 2850 Hz <b>OFF</b> x3 times + 1.5 sec <b>OFF</b> )	ISO8201 High tone - US Temporal Tone HF	83	27
	7	970Hz (0.5 sec <b>ON</b> 970 Hz <b>OFF</b> x3 times + 1.5 sec <b>OFF</b> )	ISO8201 Low tone - US Temporal Tone LF	92	24

## WARRANTY

Olympia Electronics guarantees the quality, condition and operation of the goods. The period of warranty is specified in the official catalogue of Olympia Electronics and also in the technical leaflet, which accompanies each product. This warranty ceases to exist if the buyer does not follow the technical instructions included in official documents given by Olympia Electronics or if the buyer modifies the goods provided or has any repairs or re-setting done by a third party, unless Olympia Electronics has fully agreed to them in writing. Products that have been damaged can be returned to the premises of our company for repair or replacement, as long as the warranty period is valid.

Olympia Electronics reserves the right to repair or to replace the returned goods and to or not charge the buyer depending on the reason of defection. Olympia Electronics reserves the right to charge or not the buyer the transportation cost.

## HEAD OFFICE

72nd km. O.N.R. Thessaloniki-Katerini



P.C. 60061 Greece

[www.olympia-electronics.gr](http://www.olympia-electronics.gr)

[info@olympia-electronics.gr](mailto:info@olympia-electronics.gr)

## Certification

The waterproof sounder BS-530/1/WP is certified from H.E.E.Q.A.C. Also H.E.E.Q.A.C. controls the production under CPR number:

<b>BS-530/1/WP</b>	
<b>WATERPROOF SOUNDER</b>	0848
<b>0848-CPR-023</b>	<b>16</b>
<b>EN 54-3:2001 +A1:2002 +A2:2006</b>	
<b>KOLINDROS PIERIAS</b>	
<b>60061 GREECE</b>	
	